

Addressing issues in Hospital Wastewater using Algal bacterial consortium

Ph.D. Student in Environmental Engineering

Presented by: Ubhat Ali

Under the supervision of: Dr. Pratik Kumar



विद्यया धनं सर्वधनं प्रधानम्

IIT JAMMU


DEPARTMENT OF CIVIL ENGINEERING
INDIAN INSTITUTE OF TECHNOLOGY JAMMU
JAGTI, NAGROTA, J&K – 181221, INDIA

INTRODUCTION

- The **centralized scheme** of wastewater treatment is hugely incompetent to treat nutrient pollutants, let alone emerging contaminants.
- 80% of wastewater containing these emerging contaminants flows back into the ecosystem without receiving any specialized treatment
- Also, in view of the pandemic, the wastewater is overloaded with myriads of **epidemiological vectors**.
- The Central Wastewater Treatment Plants (CWWTPs) are currently dependent on **heterotrophic microbes** for pollutant removal.
- Due to the incompetency of the CWWTPs, nutrients and persistent pollutants remain a large problem and could pose detrimental effects on the biosphere, if not catered to.
- To eliminate the problems of CWWTPs, **decentralized wastewater treatment systems (DWWTS)** are being greatly researched and developed, which could serve as **point-of-care systems** and thereby, be used for remote locations as well.

CURRENT SCENARIO


- In most developing countries including India, Hospital Wastewater (HWW) is **mixed** with Municipal Sewage.
- Daily wastewater discharge from hospitals is about **400 – 1200 L/capita/day**.
- Hospitals discharge Persistent Organic Pollutants (POPs) like Pharmaceutical compounds, chemical compounds, surfactants and antibiotic-resistant bacteria (ARB).
- The volume of wastewater generated from hospitals depends on its size and type, patient intake capacity, technical facilities and miscellaneous services provided to patients.
- Mixing of Sewage and HWW chokes the treatment units and causes the release of these ECs into the environment.

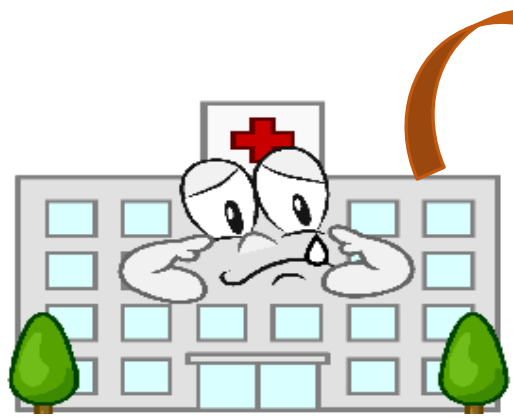





Hospital Wastewater scenario:
Increase in:

- Surfactants
- Disinfectants
- Pharmaceuticals

Centralized System

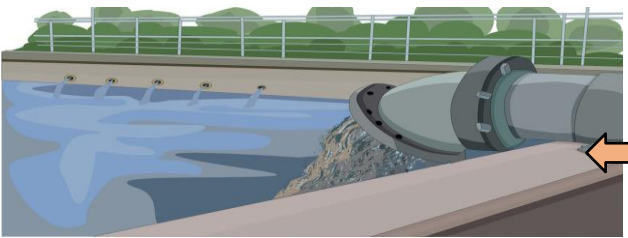

Decentralized System

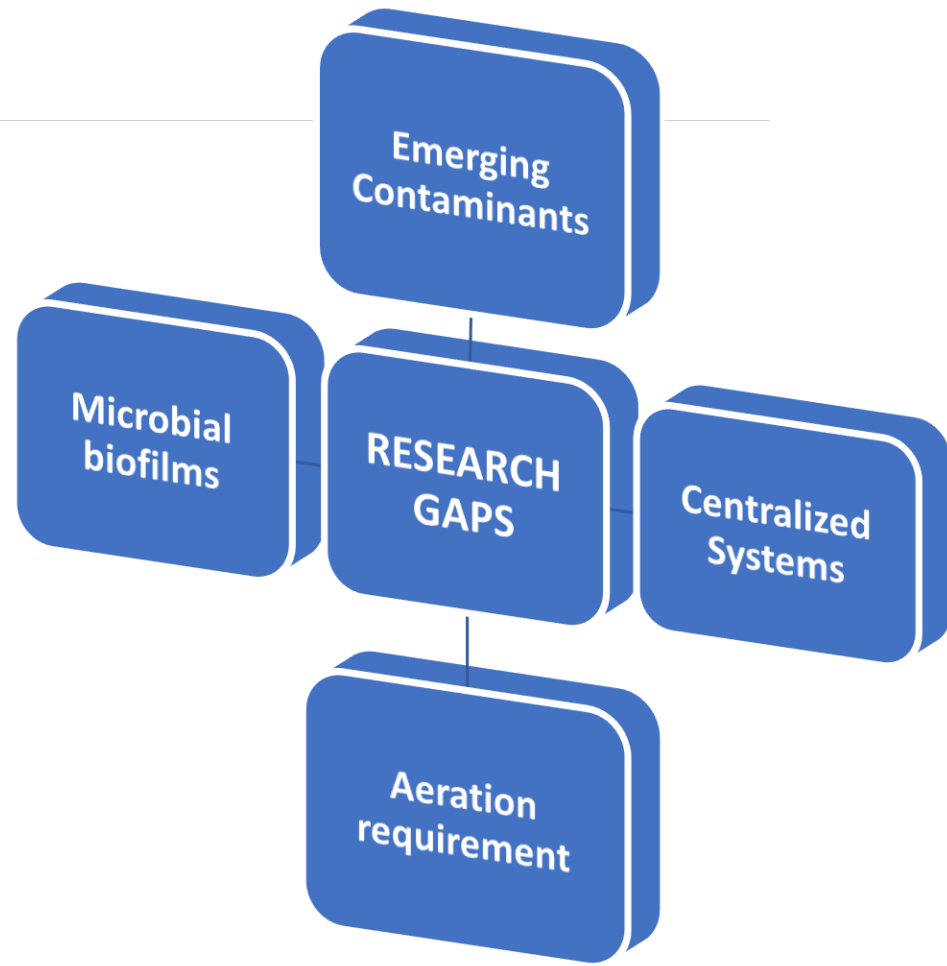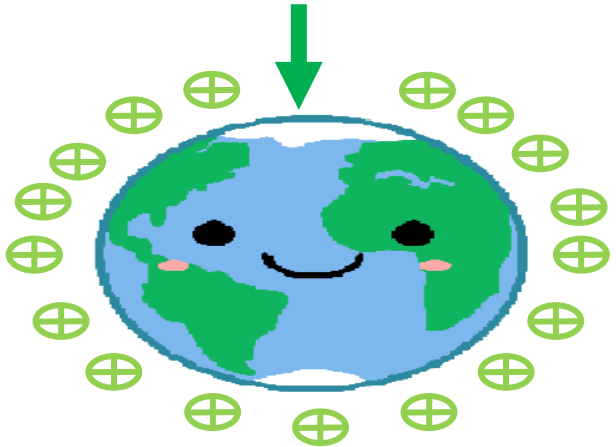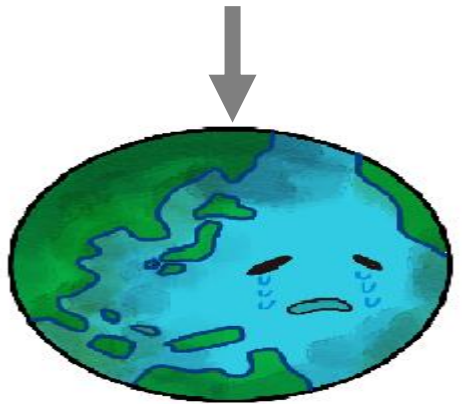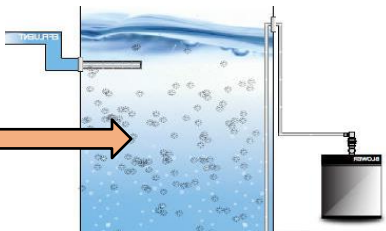

HYPOTHESES

H1: The intrinsic availability of **autotrophs** in wastewater would be used such that a **symbiotically functioning algal-bacterial community** (ABC) is cultured. It is hypothesized that this would lead to a decrease in the treatment duration, a lowering of the HRT, and an increase the overall quality of treatment along with establishing appropriate emerging contaminant removal.

H2: Due to the well-established bio-accumulation, bio-disintegration and bio-adsorption characteristics of Algae, the resulting ABC system could be a promising **sustainable** and **greener** approach to wastewater treatment.

H3: **Algae** in the ABC being **autotrophic in nature** would produce oxygen and thereby help **reduce the need for aeration**. This reduction in aeration requirement may also be attributed to the development of an ABC biofilm on the Kaldness (K1) carriers which could further economize the MBBR treatment technology.

OBJECTIVES


- To reduce the **aeration requirement** for the aerobic MBBR process by establishing a reliance on ABC.
- To achieve appreciable removal of **antibiotics**, **surfactants** and **phenols**.
- To study the **removal rates** of nutrient and ECs achieved using novel algal-bacterial consortia (ABC).
- To conduct **ecotoxicological studies** for the presence of ECs in wastewater and sludge component.
- To propose a **modular**, sustainable, economic, flexible and **GREEN** approach for HWW treatment.




METHODOLOGY





Culturing of Algae

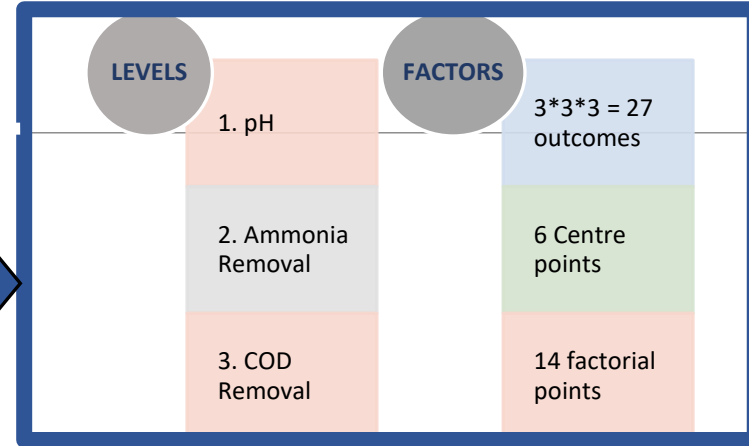

Design of Experiment using CCD

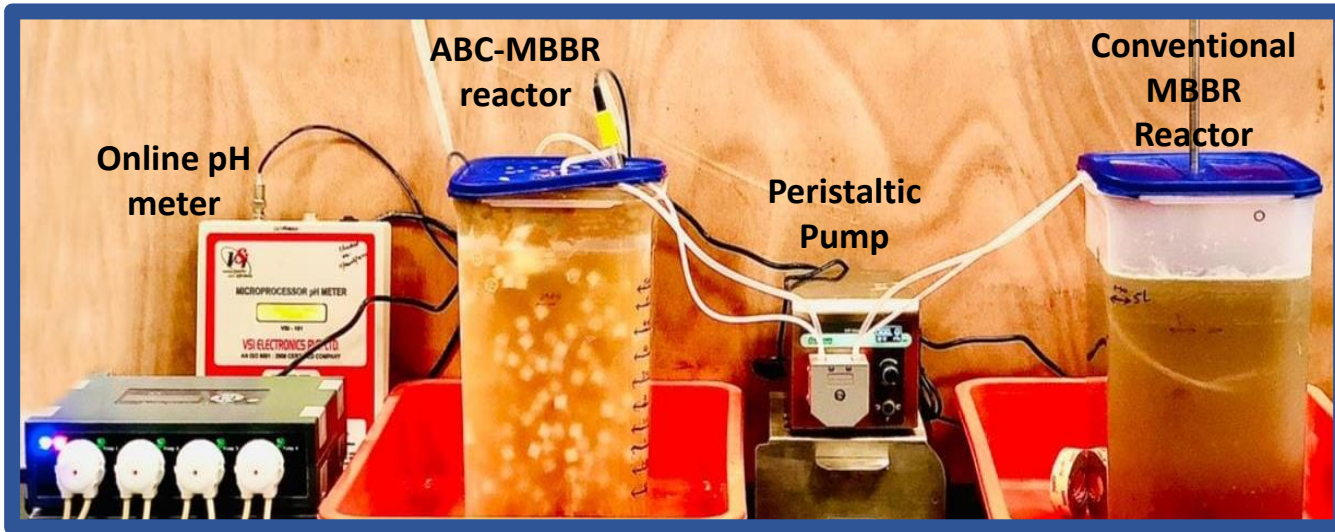

Batch Operation for acclimatization

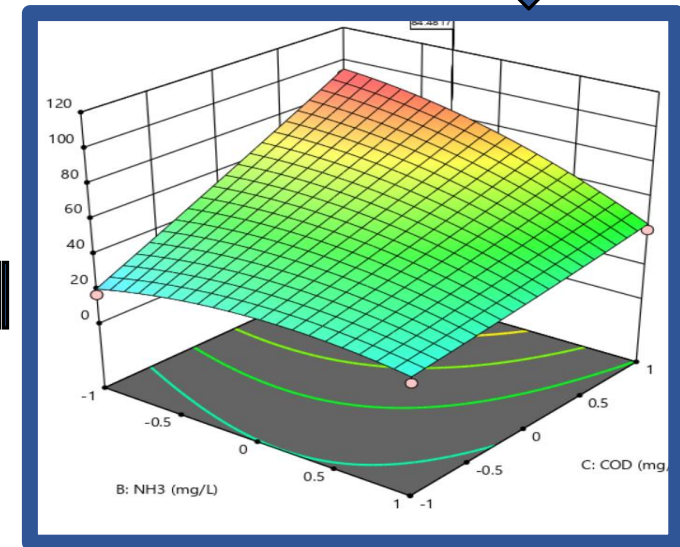

METHODOLOGY

- The acclimatized carriers and cultured algal-bacterial consortium will be studied for the removal of emerging pollutants in continuous operation (at least 45 days)
- Removal rates of the **nutrients** would also be studied in parallel.
- A **comprehensive comparative assessment** of native & conventional bacterial community-based MBBR vs. a novel and acclimatized ABC-based MBBR with respect to the anticipated emerging contaminant concentrations would be evaluated.



GPS-X™

Validation







**Techno-economic
analysis**



SimaPro

**Life cycle
assessment (LCA)**

PRELIMINARY RESULTS

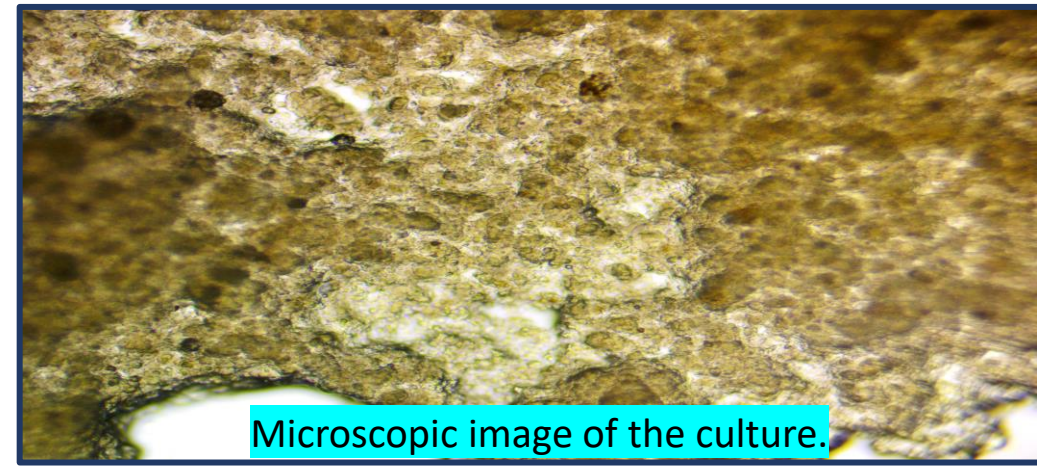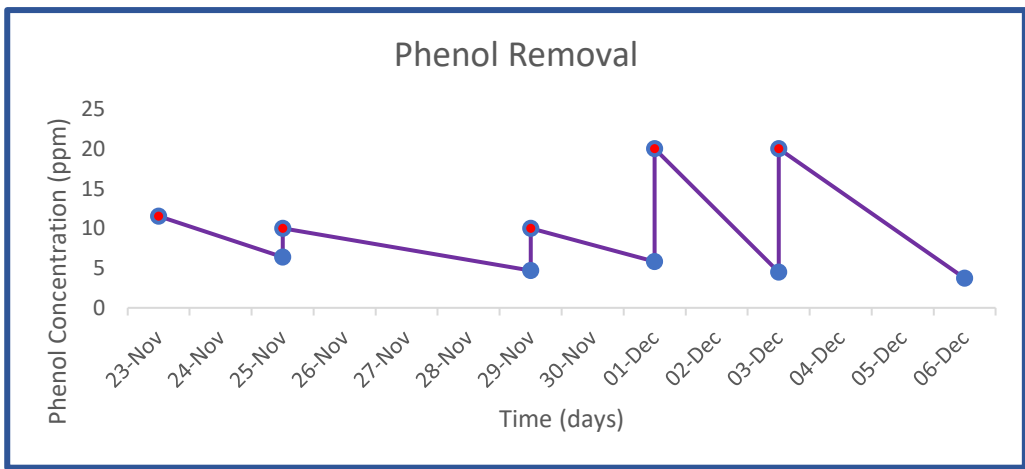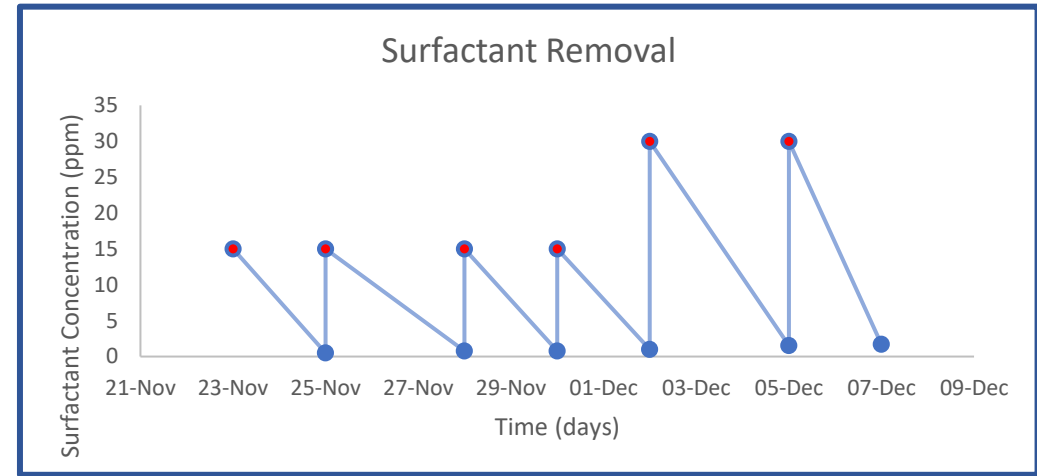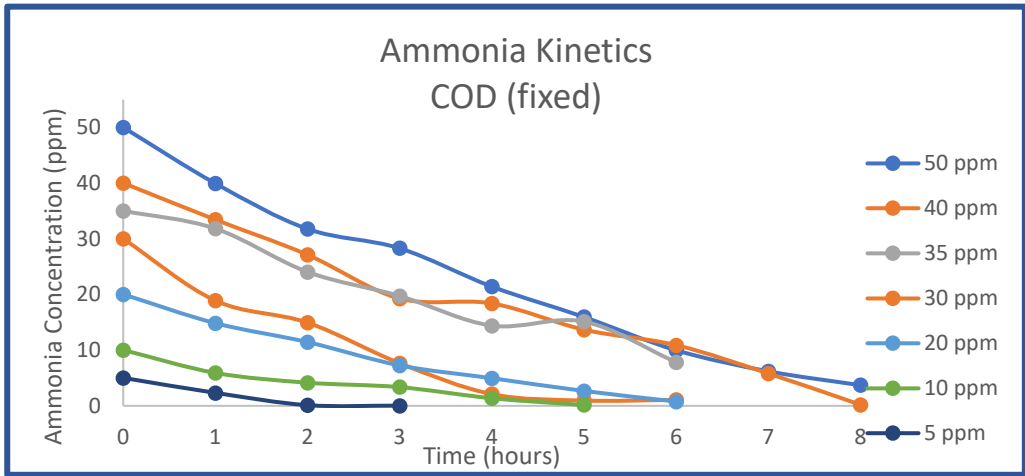

PRELIMINARY CONCLUSIONS

- The existing wastewater treatment facilities are incompetent to remove nutrient and organic pollutants, even in a HRT of 16 hours.
- The removal of Phenol and surfactants, i.e., the emerging contaminants (EC) was found to be highly appreciable.
- The novel algal bacterial consortia cultured in the lab is capable of removing the same in 6 – 8 hours.
- At least 70% removal for ammonia and more than 80 % COD removal has been observed.
- The continuous process would be used to simulate sewage treatment plant-like conditions at a pilot scale, along with observation of removal rates of conventional and emerging contaminants.



शिक्षाधनं सर्वधनं प्रधानम्

IIT JAMMU

ECWS-7
2023



THANK YOU