

Proceeding Paper

Rainwater Harvesting during the Covid Outbreak: A Case Study in Brazil [†]

Igor Catão Martins Vaz ^{1,*} and EneDir Ghisi ²

¹ Igor Catão Martins Vaz

² EneDir Ghisi; enedir.ghisi@ufsc.br

* Correspondence: igor.catao@posgrad.ufsc.br

[†] Presented at the 7th International Electronic Conference on Water Sciences, 15–30 March 2023; Available online: <https://ecws-7.sciforum.net>.

Abstract: This work assessed the potable water savings potential for different scenarios in a flat in Florianópolis, Brazil. An uncertainty analysis was also performed to understand which parameters most influenced the results. First, it was necessary to evaluate the water consumption and calculate the water end-uses during a home-office period due to the Coronavirus pandemic. The water end-uses were obtained by monitoring the users' consumption for sixteen days and compared with the water meter on a daily basis. The results were very close to those measured using the water meter, with an average absolute error of 5.6%. The base consumption was, on average, 249.2 litres per capita per day. With a home-office regime and uninterrupted occupation, the Coronavirus pandemic can be postulated to justify the more intense consumption patterns. Regarding the percentage of non-potable end-uses, an average of 25.8% was obtained. Potable water savings were simulated using the computer programme Netuno, version 4. Seventy scenarios were evaluated, including different rainwater catchment areas and water and rainwater demands. The main results were that the rainwater harvesting through a reduced area, 17.5% of the roof, obtained significant results compared to the simulation with the whole roof, with a potable water savings potential of 16%.

Keywords: rainwater; Water end-uses; potable water savings potential; simulation; rainwater harvesting; coronavirus

1. Introduction

One of the simplest methods to optimise water consumption is to return to the ancient knowledge of rainwater harvesting systems and use rainwater for non-potable purposes in buildings. Rainwater harvesting is a technique that has been widely known and disseminated in society for thousands of years [1]. According to Gnadlinger [1], there is no single reason why rainwater is no longer the focus of water harvesting techniques. However, the author comments that some factors were climate change, with droughts generating local inefficiency of systems, the desire for a centralised water management system and the focus on large water supply projects, such as dams and wells.

Studies on the potable water savings potential through the implementation of rainwater harvesting systems are abundant in the literature. Examples of residential buildings [2], industries and agriculture [3,4], schools and universities [5,6], and offices [7] are found in the literature. Local rainwater harvesting can decrease the number of distribution pipes and reservoirs, thus decreasing leakage losses. Lower volumes of water are also withdrawn from rivers and aquifers, which benefits the environment. Finally, using rainwater for non-potable purposes decreases the amount of water treatment chemicals. Studies on Life Cycle Analysis (LCA) have also demonstrated the potential to decrease the environmental impacts of water supply through rainwater harvesting systems [8].

Citation: Martins Vaz, I.C.; Ghisi, E.; Rainwater Harvesting during the Covid Outbreak: A Case Study in Brazil. *Environ. Sci. Proc.* **2022**, *4*, x. <https://doi.org/10.3390/xxxxx>

Academic Editor(s):

Published: 15 March 2023



Copyright: © 2023 by the authors. Submitted for possible open access publication under the terms and conditions of the Creative Commons Attribution (CC BY) license (<https://creativecommons.org/licenses/by/4.0/>).

Recently, with the Coronavirus pandemic, the discussion has focused on optimised water systems and management. This necessity also includes the reports of the Intergovernmental Panel on Climate Change (IPCC) and the world's focus on water safety projects [9]. Water is a crucial asset towards sustainable and resilient cities and vital towards health and society equity. According to the sixth Sustainable Development Goal (SDG) of the United Nations (UN), one of the global goals is to sustainably ensure water and sanitation.

All this information, the workplace change, fewer commuting schemes, and less intranational and international travel, has caused modifications in many water flows. Not only have the consumption patterns been changing, but also the efficiencies of optimisation systems such as rainwater harvesting and water-saving appliances.

Kalbusch et al. [10] evaluated the water consumption changes in Joinville, Brazil, with the outbreak of the Coronavirus pandemic. According to statistical tests, changes were observed in the consumption pattern of commerce, industry, and public activities, with significant modifications. An increase of 11% in residential water consumption was also observed but without statistical relevance. Balacco et al. [11] also observed modifications in water consumption in five different Italian cities during the pandemic outbreak. The authors found that users changed to a late wake-up (10:00 a.m.) as a new habit during covid. This modification, alongside the modification in commuting schemes, influenced the total water demand of the cities.

Thus, this study aims to evaluate one case study with the water end-uses and simulate the potential of potable water savings of a rainwater harvesting system during the pandemic in southern Brazil. An uncertainty analysis was also performed to understand which parameters most influenced the results.

2. Method

The case study consisted of two parts. The first was the water consumption analysis, measuring the use frequency and flow rate of the appliances while monitoring the water meter of one flat. The measurements were made during the pandemic period, with the social isolation of users. The second part consisted of simulating the potential for potable water savings through the theoretical implementation of a rainwater harvesting system.

2.1. Object of Study and Water Monitoring

A flat in a multi-family residential building in Florianópolis, Brazil, was chosen to be evaluated for the design of a rainwater harvesting system. The definition considered estimating the water end-uses by monitoring the two residents for sixteen days. Figure 1 shows the location and floor plan of the flat. The green area shows the roof part owned solely by the flat owners, and the red area shows the part of the roof that is shared with the building and its residents. The flat is located at longitude 48°30'08" west and latitude 27°36'12" south.

The monitoring of water consumption was carried out through questionnaires on the uses of the water appliances. Both residents filled out forms for sixteen days. The specific questionnaires for each room presented items regarding the environment, water appliance, frequency of use in the day and the flow rate (litres/second or litres/cycle or litres/discharge or litres), being counted between 00:00 and 23:59 each day.

The volume of water consumed in each water appliance was measured to then calculate the water flow. A pre-established volume was measured for showers, taps, and sinks, and the filling time was recorded. For these appliances, an average of three measurements was taken. Regarding bowl-and-tank toilets, the volume of water in each flushing was measured for half and full flush.

For appliances with cycles, such as the washing machine and dishwasher, the consumption indicated in the appliances' manuals was used. For the drinking water consumption, we used the consumption indicated by the users at the end of the day, considering the average number of glasses of water drunk and the glass volume.

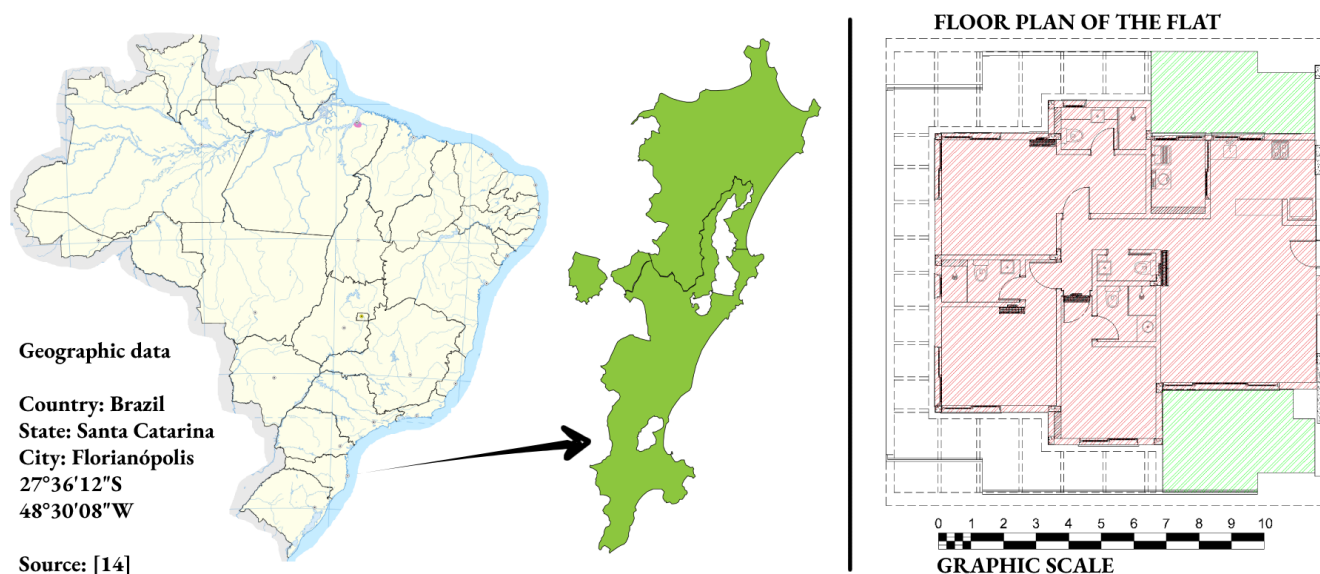


Figure 1. Location of study and floor plan of the flat.

2.2 Rainwater Harvesting System

The rainwater harvesting system was modelled based on similar works and using the computer programme Netuno, version 4. The programme, created by Ghisi and Cordova [12], is based on a deterministic water balance similar to the Yield-Before-Spillage and Yield-After-Spillage approaches. As for the simulation parameters, the programme requires local pluviometry data, water consumption characteristics, technical definitions (such as first flush volume and the runoff coefficient of the roof), and upper and lower tank volume definitions.

The goal was to analyse the potential for potable water savings under the consumption found during the pandemic times. Although, one knows that there is much variability within some of the parameters. To include the uncertainty analysis in the simulation result, 70 different scenarios were modelled based on the range of three parameters. Two values were used for the harvesting area, combined with seven water demands and five rainwater demands. Table 1 shows the data used in the simulations.

The two harvesting areas were modelled to represent the whole roof and the private part of the roof, with the shared and individual parts. This division occurs because one part is owned solely by the flat owners, while the other is shared with other building residents. To simplify the results, Private Roof is stated as PR and comprises 22 m². Shared plus Private Roof is stated as SPR and comprises 126 m². Figure 1 shows the shared part in red, while the external boundaries in green are the private part.

Table 1. Parameters used for rainwater harvesting simulation.

Parameter	Value
Pluviometry data	Obtained via INMET [13]
First flush disposal	2 mm
Harvesting area	22 m ² private roof (PR) / 126 m ² shared and private roof (SPR)
Total water demand	-15% / -10% / -5% / Water demand / +5% / +10% / +15%
Rainwater demand (% of the total water demand)	15% / 20% / 25% / 30% / 35% *
Roof runoff coefficient	0.80
Upper tank size	Equal to the average daily rainwater consumption
Lower tank size	Range between 1000 and 6000 litres (step of 250 litres)

* These results were found during the first part of the research, presented in Section 3.1.

3. Results and Discussion

3.1. Water Consumption and End-Uses

Water consumption was gathered and analysed in comparison to the water metering. The results were similar, with an absolute mean error of 5.6%. This similarity means that, on average, daily estimates of water consumption varied by $\pm 5.6\%$ to the values registered in the water meter. Daily average water consumption via water meters was 249 litres/capita/day, and the average non-potable water use was estimated to be 25.8%. We considered that rainwater could be used only for the washing machine and toilets as a non-potable source.

Table 2 shows the water flow for each of the water appliances. M1 and T1 stand for the first measurement and timing, according to the method shown in Section 2.1.

Table 2. Water flow for the water appliances.

Water Appliance	Room	M1	T1	M2	T2	M3	T3	Average Flow	Unit
Kitchen tap	Kitchen	1225	7.13	1650	8.42	1700	10.27	0.178	litres/s
Dishwasher		According to the manual						8	litres/cycle
Washing machine		According to the manual						9.4	litres/cycle
Drinking water		According to the user's measurements						-	litres/day
Washing tank		1500	5.88	1800	6.97	1600	6.28	0.256	litres/s
Shower	Bathroom 1	2200	11.33	2325	11.05	2340	10.89	0.206	litres/s
	Bathroom 2	5000	24.68	2300	10.17	2400	10.84	0.217	
	Bathroom for guests	Average of other showers						0.212	
Tap	Bathroom 1	470	4.31	450	4.26	430	3.43	0.113	litres/s
	Bathroom 2	275	2.02	390	2.77	450	3.55	0.135	
	Bathroom 3	400	3.55	450	3.84	500	3.63	0.123	
	Bathroom for guests	500	4.32	500	4.12	450	3.87	0.118	
Toilet—One flush	Bathroom 1	Length (34.5) / Width (13.3) / Depth (17.5) ¹						8.030	litres/use
	Bathroom 2	Length (35.2) / Width (14.0) / Depth (19.2) ¹						9.462	
	Bathroom for guests	Average of other one-flush devices						8.746	
Toilet—Half flush	Bathroom 1	Length (34.5) / Width (13.3) / Depth (10.0) ¹						4.589	litres/use
	Bathroom 2	Length (35.2) / Width (14.0) / Depth (16.2) ¹						7.983	
	Bathroom for guests	Average of other half-flush devices						6.286	

¹ Dimensions of the bowl-and-tank water volume used in each type of flush.

For the different scenarios of potable water demand (range between -15 and $+15\%$), the minimum and maximum daily water consumption ranged between 250 and 750 litres/day. This range shows how much variability was found within the measurements of daily water demand. Also, the daily average water consumption obtained was higher than the literature, which states an average figure of 150 litres/capita/day as a Brazilian pattern.

The distribution of the water consumption within rooms and water devices is shown in Figure 2a,b. Figure 2c shows the measured versus metered water consumption. One can see that most of the water consumption occurs in bathroom 1, bathroom 2 and kitchen, with little demand in the other rooms. Regarding water appliances, consumption was higher for showers, kitchen tap and toilets.

Comparing the results to those of Freitas and Ghisi [15], one can see that this case study flat has a higher water consumption per capita than other studies in the same region. Also, they obtained a non-potable water consumption of 42.2% of the daily water demand.

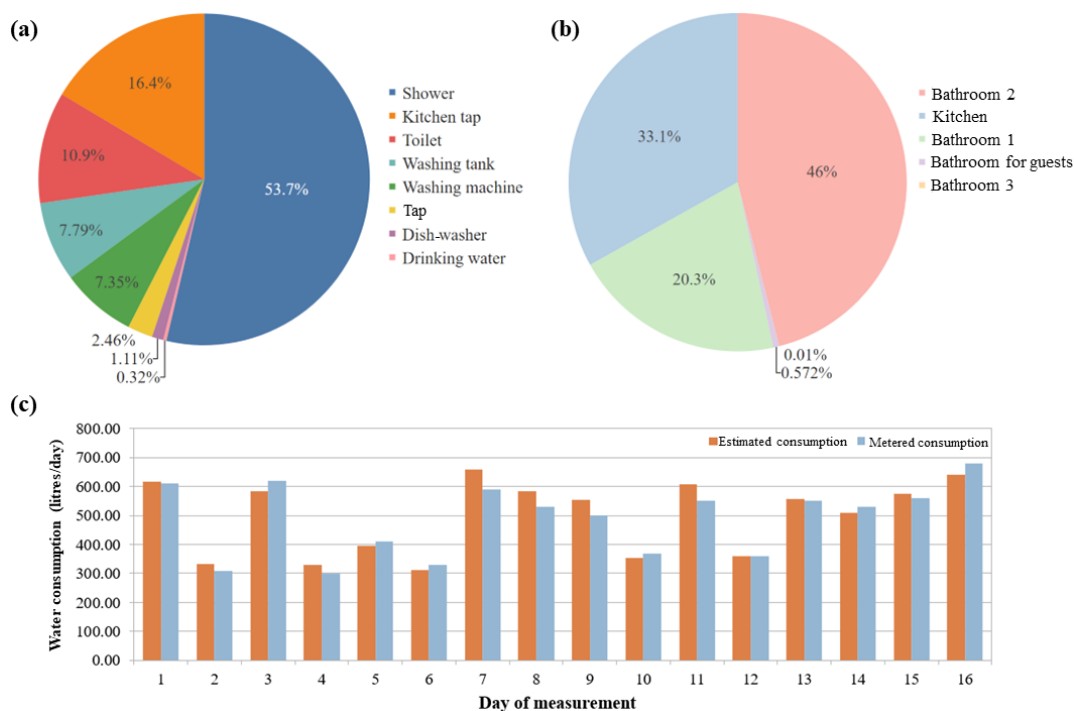


Figure 2. Results of the water monitoring.

3.2. Rainwater Harvesting System

The comparison between the PR and the SPR was the first assessment, resulting in a difference of approximately 8%. This assessment was done with the baseline consumption and the 25% non-potable water end-uses, presented in Section 3.1. By harvesting rainwater with the 126 m² roof, 24% of potable water savings were obtained, while with the 22 m² alternative, 16% savings were obtained. Both results were obtained with a lower tank of 3000 litres, indicated as the optimal technical solution.

The second assessment was the uncertainty analysis within the results obtained in the water metering. In order to do so, one ranged the water demand, according to Table 1. The results were then checked for PR and SPR. The main conclusion was that the PR, a smaller roof area for harvesting, presented more sensitivity to the total water demand. In this scenario, rainwater was scarcer, and the potable water savings potential dropped when higher water demand was included. For the SPR, almost all demands were met by the rainwater harvesting systems.

The third assessment was the range of the parameter “rainwater demand”, ranging around the figure of 25%. The main result was the opposite of the second assessment, with less impact on PR and more on SPR. One can explain such a result on the analysis that SPR provided more rainwater. In this scenario, when non-potable water was needed, rainwater would be available in response to a larger harvesting area. The PR area, on the contrary, did not present extra rainwater for the system, being less affected by the parameter.

Both assessments were engaging, showing that PR harvesting proved to be a good alternative. Although, if more non-potable (more than 25%) water is needed, the SPR alternative will become more attractive, requiring the approval of the remaining building users. Nevertheless, by dividing the potable water savings potential of the PR by the SPR results, a referential percentage of 65% is obtained. This result means that even with only 17.5% of the total roof area, the users may benefit from more than half of the potable water savings potential, being easier to install and starting a sustainable water practice within the flat. Comparing the results to Freitas and Ghisi’s [15], one can see that this study has a much lower potable water savings potential due mainly to the lower non-potable water demand. One can obtain higher figures in houses with garden and patio cleaning.

4. Conclusions

The potable water savings potential ranges from 15.80% to 24.43% when considering both roof area possibilities. The results were higher than those obtained in the literature for multi-family buildings and lower than those found for single-family buildings. Also, it was obtained that even the smaller roof area proved to be an exciting approach for the users, starting a sustainable water practice in the flat.

The flat presented higher consumption than the region's average water consumption, and one can postulate that the continuous stay of users due to pandemic isolation may have influenced the results. The non-potable water demand percentage for the flat was similar to the literature. Further studies can better understand the effect of different user patterns, helping to improve rainwater harvesting dynamics.

Author Contributions: Conceptualisation, I.C.M.V. and E.G.; methodology, I.C.M.V.; software, I.C.M.V.; writing—original draft preparation, I.C.M.V.; writing—review and editing, I.C.M.V. and E.G.; supervision, E.G. All authors have read and agreed to the published version of the manuscript

Funding: This research received no external funding.

Informed Consent Statement: Informed consent was obtained from all subjects in the study.

Acknowledgments: We would like to thank UFSC for the support and Coordenação de Aperfeiçoamento de Pessoal de Nível Superior (CAPES) for the first author's scholarship during this research.

Conflicts of Interest: The authors declare no conflict of interest.

References

1. Gnadlinger, J. *Rainwater in the Integrated Management of Water Resources in Semi-Arid Locations: Historical, Biophysical, Technical, Economic, and Socio-Political Aspects (Portuguese)*; Rainwater harvesting, manage and use—Chapter 3; Brazil, 2015.
2. Kuntz Maykot, J.; Ghisi, E. Assessment of A Rainwater Harvesting System in A Multi-Storey Residential Building in Brazil. *Water* **2020**, *12*, 546. <https://doi.org/10.3390/w12020546>.
3. Bertuzzi, G.; Ghisi, E. Potential for Potable Water Savings Due to Rainwater Use in a Precast Concrete Factory. *Water* **2021**, *13*, 448. <https://doi.org/10.3390/w13040448>.
4. Bafdal, N.; Dwiratna, S. Water Harvesting System as an Alternative Appropriate Technology to Supply Irrigation on Red Oval Cherry Tomato Production. *Int. J. Adv. Sci. Eng. Inf. Technol.* **2018**, *8*, 561. <https://doi.org/10.18517/ijaseit.8.2.5468>.
5. Ghisi, E.; Rupp, R.F.; Triska, Y. Comparing Indicators to Rank Strategies to Save Potable Water in Buildings. *Resources, Conservation and Recycling* **2014**, *87*, 137–144. <https://doi.org/10.1016/j.resconrec.2014.04.001>.
6. Martins Vaz, I.C.; Ghisi, E.; Thives, L.P. Stormwater Harvested from Permeable Pavements as a Means to Save Potable Water in Buildings. *Water* **2021**, *13*, 1896. <https://doi.org/10.3390/w13141896>.
7. Proença, L.C.; Ghisi, E. Assessment of Potable Water Savings in Office Buildings Considering Embodied Energy. *Water Resour. Manag.* **2013**, *27*, 581–599. <https://doi.org/10.1007/s11269-012-0203-1>.
8. Marinowski, A.K.; Ghisi, E. Environmental Performance of Hybrid Rainwater-Greywater Systems in Residential Buildings. *Resour. Conserv. Recycl.* **2019**, *144*, 100–114. <https://doi.org/10.1016/j.resconrec.2019.01.035>.
9. IPCC. *Summary for Policymakers In: Climate Change 2022: Impacts, Adaptation and Vulnerability*; Cambridge University Press: Cambridge, UK, 2022; pp. 3–33.
10. Kalbusch, A.; Henning, E.; Brikalski, M.P.; de Luca, F.V.; Konrath, A.C. Impact of Coronavirus (COVID-19) Spread-Prevention Actions on Urban Water Consumption. *Resour. Conserv. Recycl.* **2020**, *163*, 105098. <https://doi.org/10.1016/j.resconrec.2020.105098>.
11. Balacco, G.; Totaro, V.; Iacobellis, V.; Manni, A.; Spagnoletta, M.; Piccinni, A.F. Influence of COVID-19 Spread on Water Drinking Demand: The Case of Puglia Region (Southern Italy). *Sustainability* **2020**, *12*, 5919. <https://doi.org/10.3390/su12155919>.
12. Ghisi, E.; Cordova, M. M. Netuno 4. Computer programme. Universidade Federal de Santa Catarina, Departamento de Engenharia Civil. 2014. Available online: <http://www.labee.ufsc.br/> (accessed on).
13. INMET. Meteorologic Database for Research and Teaching (Banco de Dados Meteorológicos para Ensino e Pesquisa—BDMEP, in Portuguese). BDMEP. 2021. Available online: <https://bdmep.inmet.gov.br/> (accessed on).
14. Wikipedia. Map Files of Brazil and Florianópolis. Authors: NordNordWest and Franzisquin. Both Pictures Licenced under Creative Commons. Available online: https://pt.m.wikipedia.org/wiki/Ficheiro:Brazil_location_map.svg & https://pt.wikipedia.org/wiki/Ficheiro:Floripa_2020.svg.
15. Freitas, D.A.; Ghisi, E. Economic feasibility analysis of rainwater harvesting: A case study in Imbituba, Brazil. *Urban Water J.* **2020**, *17*, 905–911. <https://doi.org/10.1080/1573062X.2020.1846062>.

Disclaimer/Publisher's Note: The statements, opinions and data contained in all publications are solely those of the individual author(s) and contributor(s) and not of MDPI and/or the editor(s). MDPI and/or the editor(s) disclaim responsibility for any injury to people or property resulting from any ideas, methods, instructions or products referred to in the content.