

Proceeding

Constructing a transparent air chamber for an innovative ventilation system in an operating room [†]

Victorien Desmars ¹, Danny Van Hemelrijck ² and Valéry Ann Jacobs ^{1,*}

¹ LUXETEC, Department of Electric Engineering and Energy Technology, Vrije Universiteit Brussels, Brussels, Belgium

² Mechanics of Material and Constructions, Vrije Universiteit Brussels, Brussels, Belgium

* Correspondence: Victorien.Desmars@ulb.ac.be, Tel.: +33-6-59747108; Valéry.Ann.Jacobs@vub.be ; Danny.Van.Hemelrijck@vub.ac.be

[†] Presented at the 18th International Conference on Experimental Mechanics, ICEM18, Brussels, 2018

Published:

Abstract: While surgical techniques have been improving during last decades to the benefit of patients' safety, infections are still recorded. It is in part due to airborne particles entering the wound during surgery, as a result of the disturbance of the unidirectional flow of clean air (LAF) by the presence of a surgical luminaire system. To prevent this negative interaction, an integrated system of light and ventilation has been designed. However, this system is still conceptual and a mechanical design is needed to prototype the system. Compliance with the European standard on surgical luminaires and the Heating, Ventilation and Air-Conditioning (HVAC) guidelines for operating rooms (OR) have to be checked for this prototype. We thus perform a structural analysis of the air chamber using Autodesk Inventor and SCIA Engineer considering different partitioning scenarios. The impact of each configuration is then assessed by considering the optical performance in the optical simulation TracePro. By comparing shifts in the results to a reference scenario an optimized configuration can be chosen. By consequence, a good balance between optical performance and mechanical strength is determined and leads to an optimized supporting solution. This mechanical design further enables us to build the integrated concept that aims to suppress the negative interaction between light and ventilation in the operating theater.

Keywords: air chamber; surgical luminaires; ventilation

1. Introduction

The Belgian Superior Health Council reports in 2013 that 2% of surgical procedures lead to Surgical Site Infections (SSI) [1]. Postoperative infection rates of 1.6%, 2.6% and 5.6% are respectively reported in Germany, the USA, and low and middle-income countries [2]. This rate rises to 15% in Brazil [3]. One of the mechanisms that lead to SSI relies on microscopic organisms, such as bacteria, which are in suspension in the air. These airborne microorganisms are transported by particles like dust or aerosols. Usually, these are harmless due to the protection of the skin which acts as a natural defense barrier. However, during a surgery the skin is opened, allowing for particles to enter the wound. Depending on various factors, as the immune system of the patient, the point of entry, the bacterial load etc... the microorganisms may thrive and lead to an infection. Irrespective of (HEPA) filtering the air supply, bacteria, mainly originating from the operating staff and the patient itself, can become airborne and infect the patient.

To control air quality and minimize contamination, technical standards and guidelines on the design of the HVAC system were written. Ultra-clean ventilation systems, commonly known as laminar air flow (LAF) are usually prescribed. LAF systems provide a unidirectional flow of air. They are commonly mounted in the ceiling (vertical flow). The air must flow from the cleanest source (LAF

system) to the least clean area (outside the operating room) without mixing clean and non-clean air before reaching the wound. However, their efficiency is limited by the presence of a surgical luminaire system beneath the ventilation outlet which disturbs the pattern of the laminar flow [4]. It creates turbulence allowing for microorganisms from outside the ultra-clean zone to enter the wound zone. To prevent this negative interaction between the ventilation system and the surgical lighting, Jacobs et al. dealt with the optical design of an integrated light and ventilation system, which concept is subject to a patent [5]. The positions of the two main components are switched, the luminaires being above the outlet of the ventilation system. The air is provided from the sides (A) where it is filtered by HEPA filters, then enters (B) a chamber which lower surface is a perforated plate that produces a downwards laminar airflow (C). Figure 1 from [6] details this configuration.

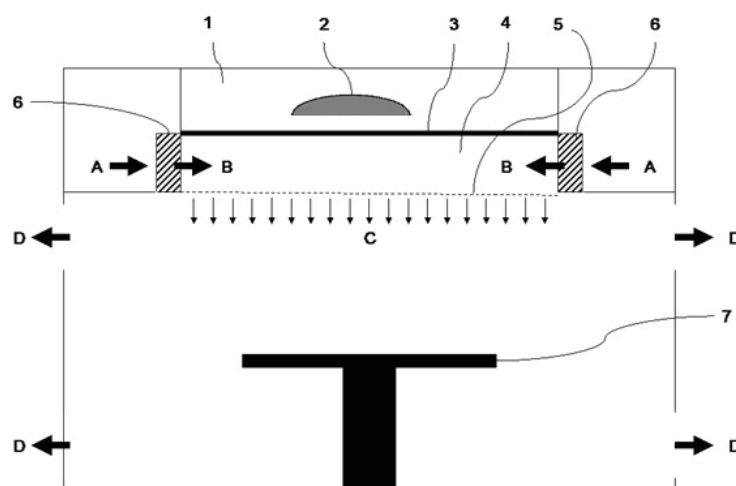


Figure 1. Innovative concept of an OR that integrates light and ventilation: 1. Light chamber with transparent floor; 2. Primary mobile luminaire; 3. Pressure rooms; 4. Transparent ceiling; 5. Perforated transparent air outlet; 6. HEPA filters; 7. Operating table; A. Conditioned air supply; B. Filtered ultra-clean air; C. Downward flow; D. Air outlet

However, this system is still conceptual and needs a mechanical design to be built: currently air chambers often consist of metal plates but switching the positions of luminaires and ventilation requires the chamber to be transparent and be able to comply with the European standard for surgical luminaires [6]. As the material of the air chamber needs to be changed, its ability to be perforated and produce a laminar airflow complying with the Heating, Ventilation and Air-Conditioning (HVAC) guidelines for operating rooms has to be checked too. Jacobs et al. already showed that the integrated system is able to comply with the European standard concerning surgical luminaires [7]. However, this work did not consider the construction aspects. The plates constituting the upper and lower surfaces of the chamber can only be supported on their sides, due to the presence of the luminaire system. Being loaded by their self-weight and a force induced by the airflow, they are subject to a bending moment and deflect. This physical phenomenon determines both their dimensions and the mounting method and impacts the optical efficiency of the system. We thus perform a design aiming at optimizing the supporting structure of this air chamber regarding its optical properties.

2. Structural analysis of the transparent surfaces

To design the transparent plates of the chamber, several parameters, which are dependent on each other, need to be determined: the material, the partitioning, the thicknesses of the plates constituting the chamber, the supporting elements and the diameter and pitch of the perforations.

2.1. Material

The transparent plates constituting the air chamber are chosen in polycarbonate. This material has interesting properties for the medical sector [8]: It has glasslike optical properties and provides

"an unusual combination of strength, rigidity, and toughness" which prevents dangerous failures. Its high heat resistance enables its placement close to a lighting system without unwanted deformations. In addition, it can be disinfected using usual methods, crucial asset for a use in OR. Finally, polycarbonate can be drilled without the formation of cracks, which is necessary to produce the laminar air flow [9].

2.2. Partitioning

An air chamber of 3x3m is chosen, as it is the largest size used in practice, allowing an incident angle of light about 24° assuming dimensions given in part 3. A single plate of this dimension would not be optimal, leading to a thick (4cm) and heavy element (430kg). It is thus necessary to partition the plates in a certain number of elements to determine. This number is crucial to derive the remaining unknowns and have a strong impact on light as the supporting elements cannot be made of polycarbonate and are thus chosen in steel. Six scenarios of partitions are considered: 10x10, 8x8, 6x6, 5x5, 4x4 and 3x3 elements.

2.3. Polycarbonate plates

The polycarbonate plates, being loaded by their self-weight, are subject to a bending moment, leading to a deflection. The maximum deflection is determined by the usual deflection limits used in the construction sector. They minimize the possibility of damage and provide a feeling of safety for the room occupants by limiting the maximum displacement of elements to their span divided by 240 for non-brittle material.

To determine the minimum thickness allowing to comply with the deflection rule, polycarbonate plates corresponding to the different scenarios are modeled in Autodesk Inventor, and a deflection analysis is performed. The plates being likely to be supported on a small surface on each edge, a rotation at the supports is forecasted, modeled by pinned connections. The self-weight is defined, while the load induced by the airflow is not considered, as the maximum air velocity of $v = 0.35$ m/s [10] prescribed by standards leads to a pressure of 0.0735 Pa, which is negligible compared to the self-weight of the thinnest plate (2mm) inducing 23.5 Pa. The lower and upper surfaces of the chamber being respectively constituted of perforated and non-perforated plates, the analysis is performed for both. Circular perforations with a 5mm diameter and a pitch of 15x15mm is used, as [11] showed that a laminar airflow is achievable for these values. The results of the Autodesk Inventor analysis on polycarbonate plates are summarized in Table 1.

Table 1. Deflection limit δ_{max} , deflections δ and thicknesses t of perforated and non-perforated polycarbonate plates for the considered partitioning scenarios. The perforated plate analysis failed to compute for the 4x4 and 3x3 scenarios due to the high number of perforations. Deflections were deducted from the average increase factor between non-perforated and perforated plates of the other scenarios.

	δ_{max} [mm]	Non-perforated plates		Perforated plates	
		t [mm]	δ [mm]	t [mm]	δ [mm]
10x10	1.25	2	0.44	2	0.50
8x8	1.56	2	1.07	2	1.22
6x6	2.08	3	1.50	3	1.72
5x5	2.50	4	1.76	4	2.01
4x4	3.12	5	2.75	6	2.17 ±0.020
3x3	4.17	8	3.38	8	3.86 ±0.035

2.4. Inner supporting beams

T-profiles steel beams are chosen as supporting structure to mount the polycarbonate plates, based on the suspended ceiling model. To determine the cross-sections dimensions, a steel frame

made of 1D elements is modeled for each scenario in SCIA Engineer. Connections between steel beams prevent rotation and supports are defined as pinned and rolled. The self-weight of the beams is defined and the surface-loading of the polycarbonate plates is applied. The most efficient profiles among European standard equal flange steel tee sections [12] are chosen by checking the compliance with Eurocode 3: Design of steel structures [13]. Table 2 summarizes the final chosen profiles and the design forces and resistances. For ease of construction, the same supporting structure is considered for the lower and upper side of the chamber. The loads of the non-perforated plates are taken into account as they induce more load than the perforated ones, except for the 4x4 scenario where a plate thickness of 6mm is considered.

Table 2. Chosen profile for supporting beams, design moment M_{Ed} and shear force V_{Ed} under the Ultimate Limit Stress combination, design cross-sectional moment $M_{c,Rd}$ and shear force $V_{pl,Rd}$, maximum deflection δ_{max} and actual deflection δ under the Serviceability Limit Stress combination.

Scenario	Profile	M_{Ed} [Nm]	$M_{c,Rd}$ [Nm]	V_{Ed} [N]	$V_{pl,Rd}$ [N]	δ [mm]	δ_{max} [mm]
10x10	T25	29.1	115	43.2	10.2·103	10.5	12
8x8	T25	30.6	115	44.8	10.2·103	11.2	12
6x6	T30	46.8	188	67.0	14.1·103	9.09	12
5x5	T30	53.4	188	75.9	14.1·103	11.5	12
4x4	T35	86.3	289	119	18.6·103	9.4	12
3x3	T35	106	289	143	18.6·103	11.1	12

3. Optical assessment

To assess the impact of each scenario configuration on the optical properties, the inner supporting structure, modeled in Autodesk Inventor, is imported into TracePro. The following elements are imported:

- a measurement plane of 60×60 cm located at ground level to plot the illuminance on a 128×128 pixels grid
- The mounting structure of the chamber, defined with a reflectance of 0.4 and an absorbance of 0.60 corresponding to stainless steel [14]. Its lower and upper sides are respectively located at 1.50 m and 2.20 m.
- A lighting system representing the configuration proposed by [7] for the surgical luminaire: 214 LEDs arranged in concentric regular polygons in a single plane around a center. The diameter of the system is 85 cm. Each LED has a luminous flux of 60 lumen equipped with focusing optics, resulting in an intensity distribution with a FWHM of 7 ° for each LED. Rays of monochromatic light with a wavelength $\lambda = 546.1\text{nm}$ are used. It is located at a distance of 2.70m from the center point of the measurement plane. The incident angle varies among 0°, 12° and 24° for a center of the lighting system along the z axis and the diagonal of the chamber (Figure 2), totaling 5 studied positions.

For a given scenario and position of the luminaire system, the error percentage on the illuminance compared to a reference situation, where no supporting structure is present, is calculated for each pixel according the following formula:

$$e = (E - E_{ref}) / E_{ref}, \tag{1}$$

where E is the illuminance for the considered configuration and E_{ref} the illuminance for the reference situation. The error uniformity defined by the average error divided by the maximum error is also computed. Results can be read in Table 3.

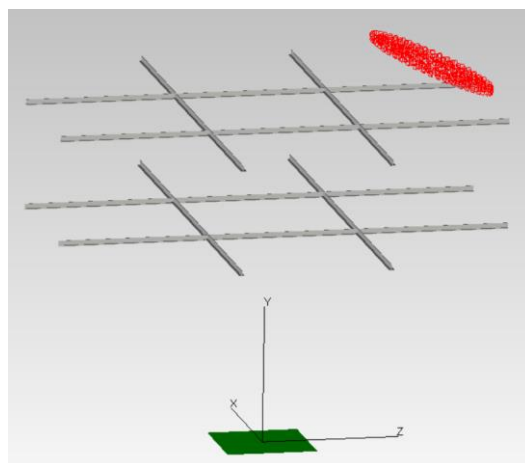


Figure 2. TracePro model constituted of the measurement plane (green), the supporting frame (grey) and the lighting system (red) for the 3x3 scenario with an incident angle of 24°

Table 3. Average of maximum errors e_{max} and of error uniformities u on the 5 studied positions

	3x3	4x4	5x5	6x6	8x8	10x10
e_{max}	22%	37%	32%	26%	43%	34%
u	0.60	0.50	0.56	0.47	0.55	0.48

The effect of the supporting frame is lower in the 3x3 scenario compared to other scenarios: The mean illuminance error is the lowest and the uniformity the highest, meaning that the slight decrease of illuminance is quasi-uniform, which can be seen by the absence of a pattern when performing a spatial plot of the error.

4. Conclusion

A mechanical design for an integrated system for lighting and ventilation in the surgery room has been developed. A segmentation of the transparent chamber in 3x3 has been chosen as this combines low impact on the illuminance, ease of construction and lightness of the structure. The remaining structural elements do not affect the optical performance and can then be designed. L35x4 profile steel beams are chosen for the edges of the upper and lower surfaces. Steel plates close the chamber on the four sides and transfer the load of the chamber to the supports. Two of those plates have connections for the ventilation system. Hangers are planned to take the total load of the chamber depending on the ceiling of the operating room and the luminaire system. Finally, the connections between steel elements can be designed. This mechanical design, optimized for its structural and optical properties, allows to build the integrated concept aiming at the suppression of negative interactions between light and ventilation in operating theaters. An assessment of this innovative system will validate this solution to reduce post-operative infections.

Acknowledgments: No funding was received in support of the research work nor for covering costs to publish in open access.

Author Contributions: Victorien Desmars develops his master thesis under the supervision of the promoters Valéry Ann Jacobs and Danny Van Hemelrijck. Valéry Ann Jacobs and Victorien Desmars designed the simulations. Victorien Desmars performed them. Valéry Ann Jacobs and Victorien Desmars wrote the paper.

Conflicts of Interest: The authors declare no conflict of interest.

References

1. Ramachandran, S.; Research Associate; Healthcare (EMEA) Surgical Site Infections in Europe – Paying too High a Price Available online: <http://www.frost.com/prod/servlet/market-insight-print.pag?docid=85996734> (accessed on Apr 29, 2018).
2. Tartari, E.; Weterings, V.; Gastmeier, P.; Baño, J. R.; Widmer, A.; Kluytmans, J.; Voss, A. Patient engagement with surgical site infection prevention: an expert panel perspective. *Antimicrobial Resistance & Infection Control* **2017**, *6*, 45, doi:[10.1186/s13756-017-0202-3](https://doi.org/10.1186/s13756-017-0202-3).
3. Nastase, I.; Croitoru, C.; Vartires, A.; Tataranu, L. Indoor Environmental Quality in Operating Rooms: An European Standards Review with Regard to Romanian Guidelines. *Energy Procedia* **2016**, *85*, 375–382, doi:[10.1016/j.egypro.2015.12.264](https://doi.org/10.1016/j.egypro.2015.12.264).
4. Aganovic, A.; Cao, G.; Stenstad, L.-I.; Skogås, J. G. Impact of surgical lights on the velocity distribution and airborne contamination level in an operating room with laminar airflow system. *Building and Environment* **2017**, doi:[10.1016/j.buildenv.2017.09.024](https://doi.org/10.1016/j.buildenv.2017.09.024).
5. Improved system and method for ventilation and illumination of an operating room Available online: <https://patents.google.com/patent/EP3075368A1/sv> (accessed on Apr 29, 2018).
6. International Electrotechnical Commission. *IEC 60601-2-41: Medical electrical equipment Part 2-41: Particular requirements for basic safety and essential performance of surgical luminaires and luminaires for diagnosis*; 2009
7. Jacobs, V. A. Design considerations for LED based surgical luminaries. PhD Thesis, Vrije Universiteit Brussel, Brussels, 2015.
8. Powel, D. Medical Applications of Polycarbonate Available online: <https://www.mddionline.com/medical-applications-polycarbonate> (accessed on Apr 29, 2018).
9. Nau, A.; Scholtes, B.; Rohleder, M.; Nobre, J. Application of the hole drilling method for residual stress analyses in components made of polycarbonate. *Zeitschrift Kunststofftechnik/Journal of Plastics Technology* **2011**, 66–85.
10. Vereniging Contamination Control Nederland. Nieuwe Richtlijn: Nieuwe ziekenhuisrichtlijn in Zwitserland en Duitsland. *VCCN: Magazine* **2004**, 17.
11. Van Gaever, R. Design considerations of the operating room ventilation system: a numerical and experimental study. PhD Thesis, Vrije Universiteit Brussel, Brussels, 2015.
12. Equal flange tees, Tee sections specification, dimensions, properties. T profile accordance to standard EN 10055:1995 Available online: <http://www.b2bmetal.eu/en/pages/index/index/id/64/> (accessed on Apr 29, 2018).
13. European Committee for Standardisation *EN 1993-1-1: Eurocode 3: Design of steel structures - Part 1-1: General rules and rules for buildings*; 2005
14. Lighting Materials for Simulation Available online: <http://lighting-materials.com/> (accessed on Apr 29, 2018).



© 2018 by the authors. Submitted for possible open access publication under the terms and conditions of the Creative Commons Attribution (CC BY) license (<http://creativecommons.org/licenses/by/4.0/>).