

Flowing Blow-Offs: a Solution to Maintain Adequate Disinfectant Residuals of Dead-End Nodes in WDNs

Sara Todeschini ¹, Carlo Giudicianni ², Armando Di Nardo ², Tom Walski ³, Enrico Creaco ¹ and Stefania Avvedimento ^{1,*}

¹ Dipartimento di Ingegneria Civile e Architettura, Univesità degli Studi di Pavia, Via Ferrata 3, 27100 Pavia, Italy; sara.todeschini@unipv.it; creaco@unipv.it

² Dipartimento DICDEA, Università degli Studi della Campania "Luigi Vanvitelli", Via Roma 29, 81031 Aversa, Italy; carlo.giudicianni@unicampania.it; armando.dinardo@unicampania.it

³ Bentley Systems, Bentley Systems, Inc., 27 Siemon Company Dr., Watertown, CT 06795, USA ; Tom.Walski@bentley.com

* Correspondence: stefania.avvedimento01@universitadipavia.it

Abstract Flushing plan within a water distribution network (WDN) provide a tool for improving disinfectant residuals, and removing stagnant water. The problem of low disinfectant residuals occurs in areas of WDN such as dead-end nodes, in which low flow conditions and long residence times lead to excessive decay of the disinfectant upstream from users.

Here a methodology is presented to maintain adequate disinfectant residuals in WDNs that have numerous dead-end nodes. The slight increase in nodal outflows at these sites, which can be obtained through the opening of a blow-off at the hydrant site, can help in tackling this problem.

The methodology is based on the combined use of optimization and of flow routing/water quality modelling. The concentration of disinfectant at the source(s) and the values of nodal emitter coefficients at the critical dead-end nodes are the decisional variables to be optimized. Two objective functions are considered in the optimization, namely the total volume of water delivered in the network and the total mass of disinfectant injected into the network. The effectiveness of the methodology is proven on a real WDN, yielding an insight into the economic feasibility of the solution.

Keywords: water distribution network; disinfectant residuals; water quality; dead-end nodes

PACS: J0101

1. Introduction

Disinfection within the water distribution network (WDN) is necessary to prevent drinking water from being harmful to our health. As disinfectant travels through the pipes in a distribution system it can react with a variety of materials both within the bulk water and from the pipe wall [1]. However, in some terminal nodes of the WDN, disinfectant concentrations may become lower than the minimum values necessary to guarantee users' protection from contaminations (as prescribed by technical guidelines) [2]. The problem of low disinfectant concentrations occurs in areas such as dead-end nodes, in which low flow conditions lead to long residence times and to excessive decay of the disinfectant upstream from users. A solution to this problem may be to increase the concentration of disinfectant fed at the treatment plant. Although this is done in some cases, it may create excessive disinfectant residuals near the feeding point, resulting in taste and odor problems, as well as in the formation of carcinogenic disinfection-by-products (DBPs)[3]. Another possible solution to the problem lies in the use of additional disinfectant booster stations [4,5,6,7]. However, these solutions cause an increase in installation and operational costs for water utility managers. Furthermore, when critical nodes are scattered over the WDN, it may be infeasible to serve all critical dead-end nodes with a reasonable number of booster stations.

This paper presents a solution to the problem of low disinfectant residual in water systems that have numerous dead-end nodes and water circulation problems. The solution proposed is based on the

slight increase in nodal outflows all day long, through the opening of a blow-off at dead-end node, to obtain a continuous flow. This increase can be obtained by proposing incentives to users, to encourage them to store water in household tanks at remote nodes, to be used for instance for irrigation purposes. Otherwise, a tap can be slightly opened at the hydrant-site in proximity of the generic critical dead-end node. The opening degree of these devices must be modulated in such a way as to obtain the smallest increase in pipe flow that enables meeting the minimum concentrations of disinfectant at downstream critical nodes of 0.2 mg/L as prescribed by the current regulation. Obviously, nodal pressure deficits must also be prevented when outflows are increased.

2. Methods

The plan of nodal blow-offs to prevent low disinfectant concentrations in WDN can be developed by making use of models that simulate WDN behavior in terms of both flow routing and water quality (disinfectant decay), such as EPANET [8] or WaterGEMS® [9].

In these pieces of software, flow through an open hydrant is simulated as an emitter, with pressure-driven demand Q given by Eq. (1):

$$Q = e P^n \quad (1)$$

where Q is the flow through hydrant ($l\ s^{-1}$), e is the emitter coefficient ($l\ m^{-n}\ s^{-1}$), P is the pressure upstream of hydrant (m) and n is the emitter exponent (equal to 0.5). Using the emitter object, the flushing outflow rate in the considered node depends on the value of the pressure in each time step. The modulation of nodal outflows can be tackled as an optimization problem, in which compromise solutions are sought for between two objective functions (f_1 and f_2) to be minimized.

The first objective function f_1 is to minimize the total volume of water delivered in the network Vol (m^3), given by Eq. (2):

$$f_1 = Vol = \sum_{j=1}^{N_{\Delta t}} \sum_{i=1}^{n_n} q_{i,j} \Delta t \quad (2)$$

where $q_{i,j}$ is the flow rate delivered at the i -th node ($m^3\ s^{-1}$), n_n is the total number of nodes, Δt the j -th time step(s) and $N_{\Delta t}$ the total number of steps of the simulation. The variable Vol includes all nodal outflows (leakage from WDN pipes + standard outflow + additional outflow considered for fixing disinfectant residuals).

The second objective function f_2 is to minimize the total mass of chlorine fed into the network W (kg), given by Eq. (3):

$$f_2 = W = C_{cl} \sum_{j=1}^{N_{\Delta t}} \sum_{i=1}^{n_n} q_{i,j} \Delta t \quad (3)$$

where C_{cl} is the concentration of disinfectant imposed on supply ($kg\ m^{-3}$). Indeed, f_2 can be simply assessed by multiplying $f_1 = Vol$ by C_{cl} .

The decision variables are C_{cl} and the values of the emitter coefficients e at the n_n critical nodes of the network. These emitters can be considered as elements of a vector $e = (e_1, e_2, \dots, e_{n_n})$.

Two constraints were considered in the methodology:

- (1) a minimal residual pressure $h_{min} \geq 12+10 = 22$ m (12 m is the height of the average building in the network while 10 m is the surplus of head pressure as prescribed by the Italian guidelines), and
- (2) the minimum residual chlorine concentration $C_{cl,min} = 0.2$ mg/l, as prescribed by the current regulation.

A heuristic procedure was set-up in this work to obtain this Pareto front, using the EPANET 2.0 solver in MATLAB environment [10].

3. Application

The network model considered in this work is shown in Fig. 1 [11]. It includes 623 demand nodes, 678 pipes and 1 source node, with total head ranging from 38.00 m to 42.00 m.

The network hydraulics are periodic on a 24 h cycle. To represent the daily variation in the users' demand in the system a pattern was used for the hourly demand with multiplier values ranging from

0.500 to 1.335. The total system demand is 68.54 L/s. WDN emitters were tuned in such a way as to obtain a percentage of leakage around 20%, consistently with the real WDN.

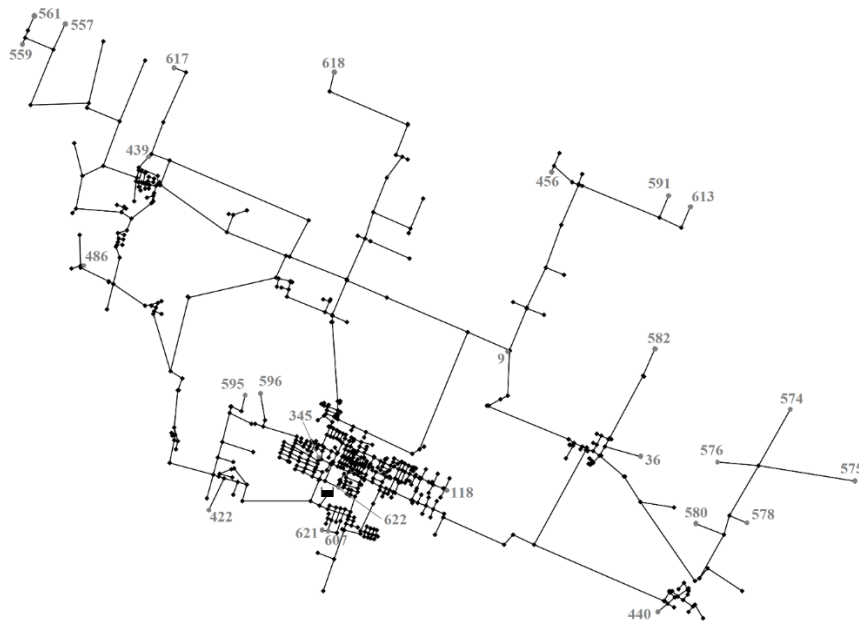


Figure 1. Water distribution network layout. Grey numbers and nodes indicate critical nodes where hydrants may be opened for chlorine concentrations at the source C_d larger than or equal to 1 mg/L.

For water quality simulations, chlorine was chosen as disinfectant. In the chlorine decay simulation, bulk and wall reactions are both first-order. The bulk decay constant (k_b) was assumed to be 1.0 d^{-1} from literature for all the links and the wall decay constant (k_w) was assumed negligible because network pipes are made of plastic material (smooth surface of pipes' internal wall) [1,12,13]. The simulations were run for 10 days of WDN operation using a time step of 1 hour, to make sure that chlorine injected close to the reservoir had enough time to reach the final nodes of the network, and to reach well-established cyclical operating conditions in the last day of simulation. The initial chlorine concentration was set at 0 at all WDN nodes.

In an initial exploratory simulation with EPANET, chlorine was injected into the source node with a constant concentration of $C_d = 1.0 \text{ mg/L}$, typical low value used at WDN sources. The software was used to identify the critical nodes, with a residual chlorine concentration below the minimum constraint of $C_{d,\min} = 0.2 \text{ mg/L}$ in the last day of WDN operation.

Specifically, 24 nodes were identified with minimum chlorine concentration below 0.2 mg/L. These critical nodes are scattered in the WDN and they are located at various dead ends.

A viable option to correct violations lies in increasing flows constantly at dead-end nodes by opening blow-offs at the critical terminal nodes. To this end, the procedure presented above was applied to the WDN for the following eight values of $C_d = 1, 1.1, 1.2, 1.4, 1.6, 2, 3, 4 \text{ mg/L}$.

4. Results

As result of the optimization problem, the approximated Pareto front of optimal solutions is shown in Fig.2. In the graph, the total mass W of chlorine injected at the source is plotted against the total volume Vol of water delivered in the network (including supply, leakage and additional outflow considered for fixing chlorine residuals).

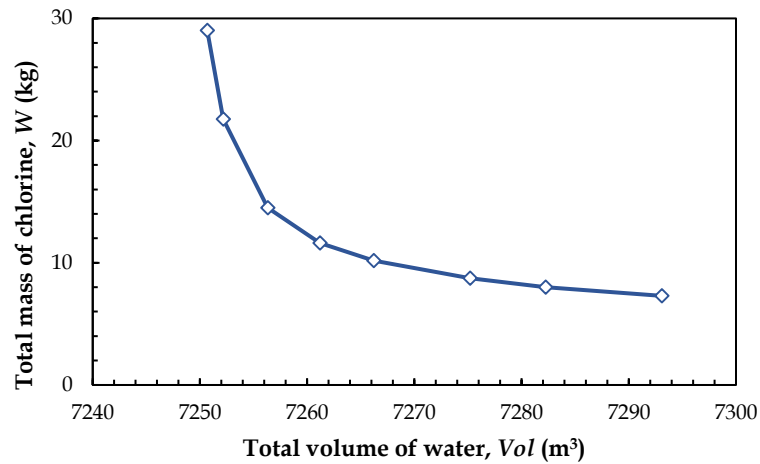


Figure 2. Pareto front of optimal solutions in the trade-off between total volume and total mass dosage

As expected, the graph highlights that higher values of W are associated with lower values of Vol and vice versa. This contrast is because, when there is no additional outflow (minimum value of Vol), it is necessary to impose high concentrations of chlorine at the source with high W value, to meet chlorine residual requirements even at dead-end nodes. On the other hand, by imposing some additional outflows (high values of Vol) near identified critical nodes, it is possible to obtain the satisfaction of the minimum concentrations of chlorine with low values of W .

Each solution of Figure 2, featuring certain values of Vol and W associated with a single value of C_{cl} , can be postprocessed for cost analysis, as is shown in Table 1. The economic analysis was carried out considering a chlorine unit cost of 4.89 €/kg and various values of water unit cost c_w .

Table 1. Economic analysis for the solutions in the Pareto front.

Chlorine conc. (mg/L)	Vol (m³)	Leakage (%)	W (Kg)	Chlorine cost (€)	C_{tot} (€) $c_w=0.005$ €/m³	C_{tot} (€) $c_w=0.0275$ €/m³	C_{tot} (€) $c_w=0.05$ €/m³	C_{tot} (€) $c_w=0.275$ €/m³	C_{tot} (€) $c_w=0.5$ €/m³	C_{tot} (€) $c_w=0.75$ €/m³	C_{tot} (€) $c_w=1$ €/m³
1	7293	20.51	7.29	36	72	236	400	2041	3682	5505	7329
1.1	7282	20.39	8.01	39	76	239	403	2042	3680	5501	7321
1.2	7275	20.32	8.73	43	79	243	406	2043	3680	5499	7318
1.4	7266	20.22	10.17	50	86	250	413	2048	3683	5499	7316
1.6	7261	20.16	11.62	57	93	256	420	2054	3687	5503	7318
2	7256	20.11	14.51	71	107	270	434	2066	3699	5513	7327
3	7252	20.06	21.76	106	143	306	469	2101	3732	5545	7359
4	7251	20.05	29.00	142	178	341	504	2136	3767	5580	7392

The calculations reported in Table 1 point out that, for the various values c_w considered, the lowest values of C_{tot} are obtained for low values of chlorine concentration C_{cl} at the source (≤ 1.4 mg/L). This corresponds to solutions with lower values of W and slightly larger values of Vol .

The additional nodal blow-offs can be considered as another kind of water loss, besides leakage along WDN pipes. In Table 1, the percentage of leakage+additional nodal blow-off, calculated with reference to the total outflow from the source, only slightly increases compared to the no-dripping scenario (20 %). In fact, the maximum value of this percentage is 20.51% (see third column in Table 1). This means that the slight opening blow-offs for improving water quality at dead-end nodes worsens water losses in the WDN only slightly. However, it must be remarked that the small value of nodal outflows may make the results of this methodology difficult to apply rigorously in the field. It is likely that the opening of hydrants or faucets in the field may cause larger outflows than those required by the methodology.

5. Discussion

Additional simulations were carried out to perform a sensitivity analysis of different parameters. In this context, a single value $C_{cl} = 1$ mg/L was considered for the chlorine concentration at the source since the effects of this parameter were considered above. A range of variation [0.75, 1.25] was considered for both the demand multiplier and the bulk decay constant, to analyze the effects of demand seasonality and chlorine decay conditions. The followed Table 2 shows the number of opened hydrants and the total daily additional outflow that correct chlorine deficits in five different scenarios.

Table 2. Number of opened hydrants and total additional outflow in five operational scenarios.

Demand multiplier	Bulk decay constant (d^{-1})	Number of opened hydrants	Total additional outflow (L/d)
0.75	1	33	102,081
1	1	26	70,800
1.25	1	23	53,798
1	0.75	12	15,819
1	1.25	39	209,058

As expected, the decrease in demand and the growth of the bulk decay constant cause the increase in the number of hydrants to open and in the hydrant outflows.

Finally, other simulations were performed to investigate if hydrants running with larger outflow (e.g., 5-10 L/s) can be flowed for a short period instead of dripping hydrants to fix chlorine residuals. However, these simulations proved that hydrants with larger outflow are ineffective at solving the problem of low disinfectant concentrations at some sites, besides causing larger head-losses in the WDN. Therefore, the use of dripping faucets and hydrants should be preferred.

Author Contributions: S.A. and E.C. wrote the paper, E.C. developed the coding, S.A. performed the analysis, C.G, T.W, S.T. and A.D.N revised the paper.

Acknowledgments: This research was conducted within the EU project Wat-Qual (Grant Agreement No. 778136).

Conflicts of Interest: The authors declare no conflict of interest.

References

- Rossman, L.A.; Clark, R.M.; Grayman, W.M. Modeling chlorine residuals in drinking water distribution systems. *J. Environ. Eng.* **1994**, *120* (4), 803-820.
- World Health Organization. *Guidelines for drinking water quality*, 4th ed., Geneva, 2011.
- Morris, R.D.; Audet, A.M.; Angelillo, I.F.; Chalmers, T.C.; Mosteller, F. Chlorination, chlorination by-products, and cancer: a meta-analysis. *Amer. J. Pub. Health.* **1992**, *82* (7), 955-963.
- Bocelli, D.L.; Tryby, M.E.; Uber, J.G.; Rossman, L.A.; Zierolf, M.L.; Polycarpou, M. Optimal scheduling of booster disinfection in water distribution systems. *J. Water. Res. Plan. Manag.* **1998**, *124* (2), 99-111.
- Tryby, M. E.; Bocelli, D.L.; Uber, J.G.; Rossman, L.A. Facility location model for booster disinfection of water supply networks. *J. Water Res. Plan. Manag.*, **2002**, *128* (5), 322-333.
- Propato, M.; Uber, J.G. Linear least-squares formulation for operation of booster disinfection systems. *J. Water Res. Plan Manag.*, **2004**, *130* (1), 53-62.
- Carrico, B.; Singer, P.C. Impact of booster chlorination on chlorine decay and THM production: simulated analysis. *J. Environ. Eng.* **2009**, *135* (10), 928-935.
- Rossman, L.A. EPANET 2 user's manual, United States Environmental Protection Agency, Cincinnati, USA, 2000.
- WaterGEMS® [Computer software]. Bentley Systems, Exton, PA.
- MATLAB 2018b, The MathWorks, Inc., Natick, Massachusetts, United States.

11. Creaco, E.; Franchini, M. A new algorithm for real-time pressure control in water distribution networks. *Water Scien. Tech.-Water Sup.*, **2013**, 13 (4), 875-882.
12. Powell, J. C.; Hallam, N.B.; West, J.R.; Forster, C.F.; Simms, J. Factors which control bulk chlorine decay rates." *Water Res.*, **2000**, 34 (1), 117-126.
13. Boccelli, D.L.; Tryby, M.E.; Uber, J.G.; Scott Summers, R. A reactive species model for chlorine decay and THM formation under rechlorination conditions. *Water Res.*, **2003**, 37 (11), 2654–2666.



© 2019 by the authors; licensee MDPI, Basel, Switzerland. This article is an open access article distributed under the terms and conditions of the Creative Commons by Attribution (CC-BY) license (<http://creativecommons.org/licenses/by/4.0/>).